



Loadlimiter 63 Metering Selection Chart

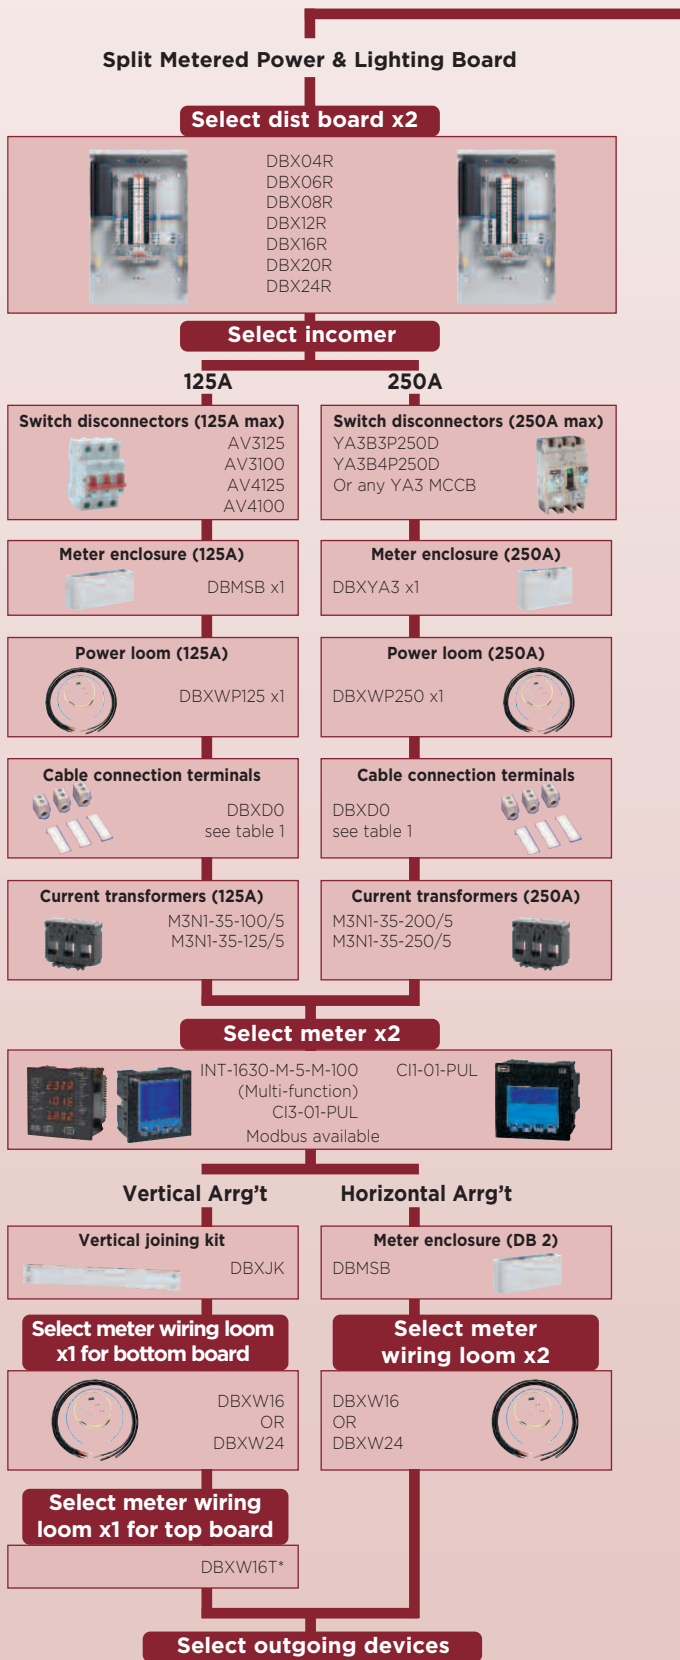

* Top board max size 16 way (vertical arrangement only)

Table 1

Quantity of AV (switch disconnectors)	DBXD0's required (125A)	DBXD0'S required (250A)	DBXCK required
1	5	3	0
2	4	2	0
2	3	N/A	1

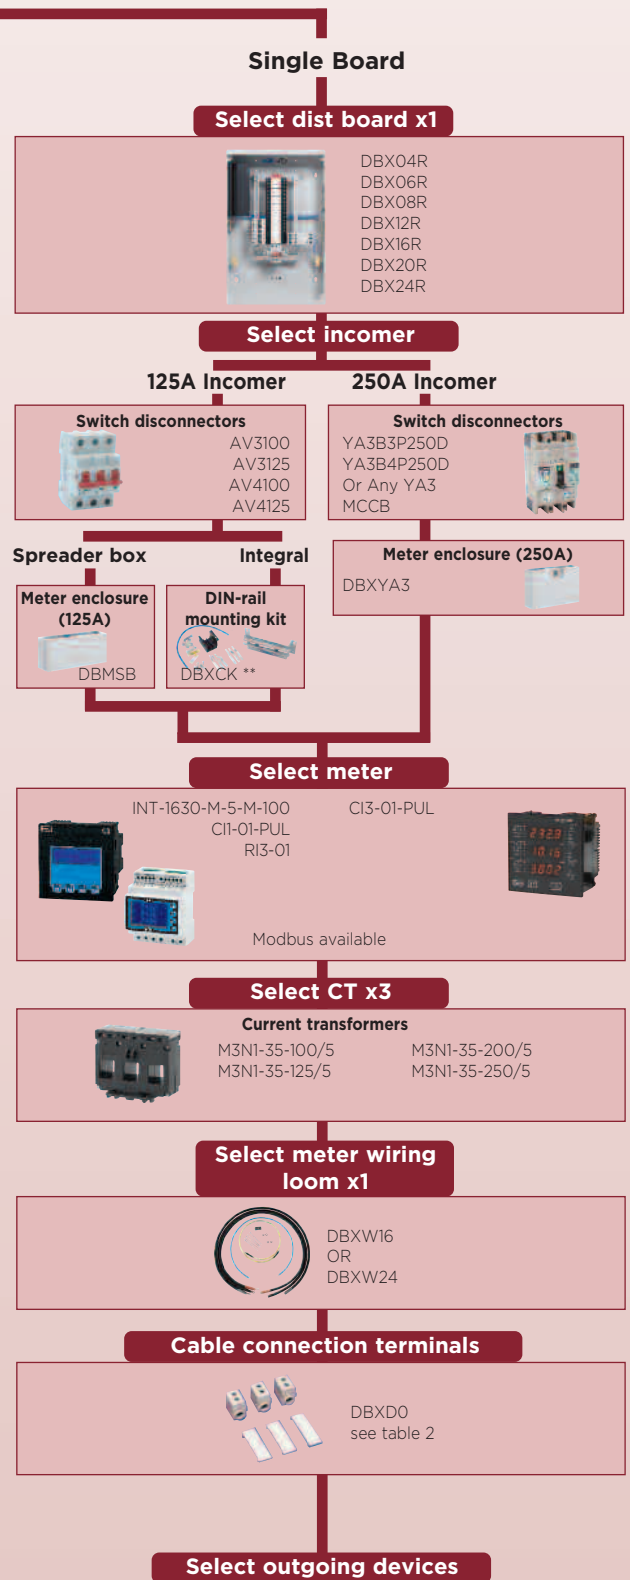

** Meter RI3-01 only

Table 2

	DBXD0's required 125A	DBXD0 required 250A	DBXWP125 (125A rated only)
Main incomer mounted in DBMSB	2	1	1
Main incomer mounted in standard position	0	0	-